


Existing Boiler (Direct Plumbed) Depressurized

NOTE
Installer must comply with all applicable codes and regulations.

NOTE
Outdoor furnace water temperature setpoint should be set at 185°F minimum.

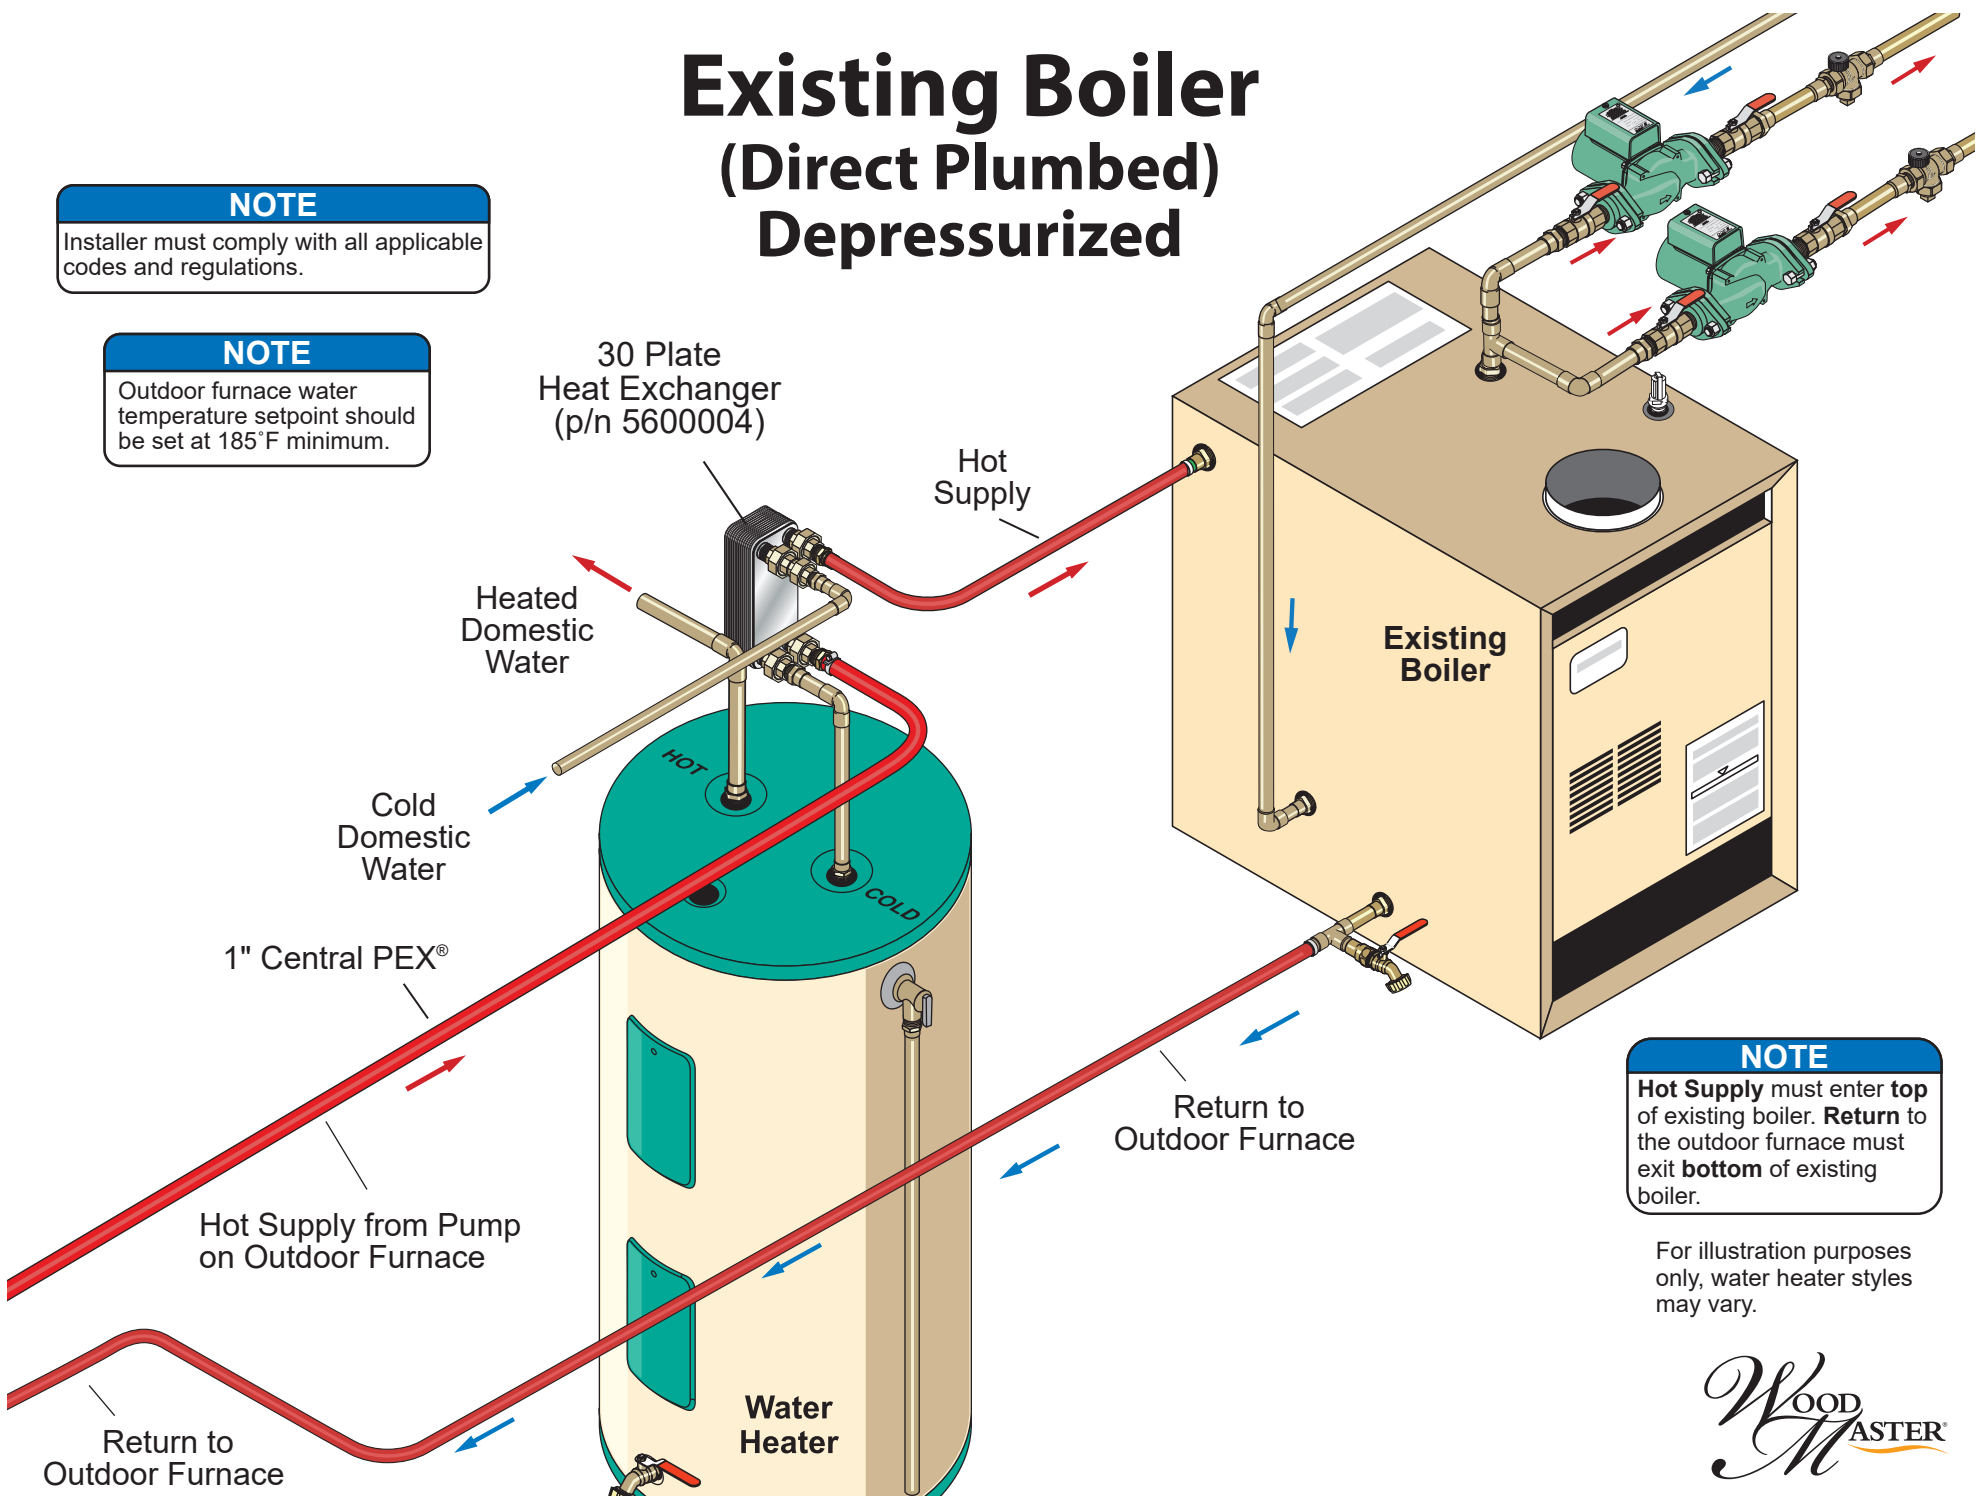

NOTE
Hot Supply must enter top of existing boiler. Return to the outdoor furnace must exit bottom of existing boiler.

For illustration purposes only, water heater styles may vary.

