


**NOTE**

This is one of several possible variations using an existing thermostat. If air conditioning is present, the air conditioner breaker may have to be shut off or a relay installed.


# Aquastat & Fan

(Option for addressing overheating on very large furnaces with minimal heat load)

Adjust strap-on setpoint to 190°F (fan will turn on above setpoint).

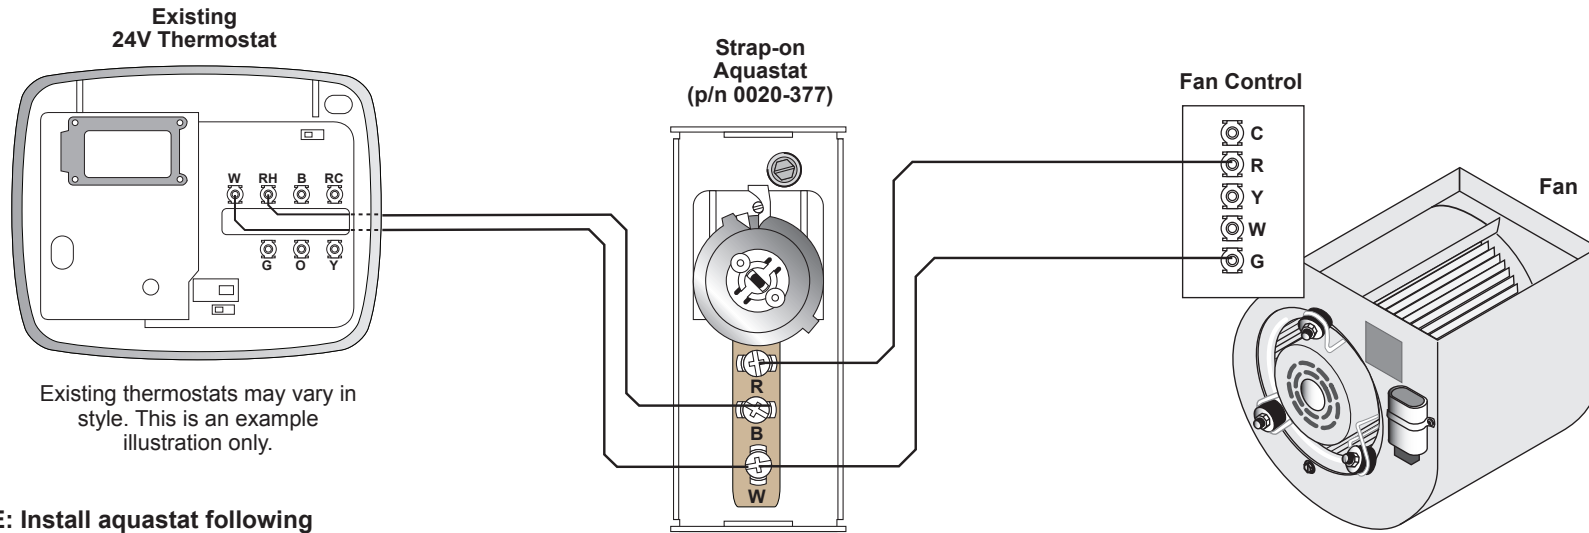

**NOTE: Install aquastat following instruction provided by manufacturer.**

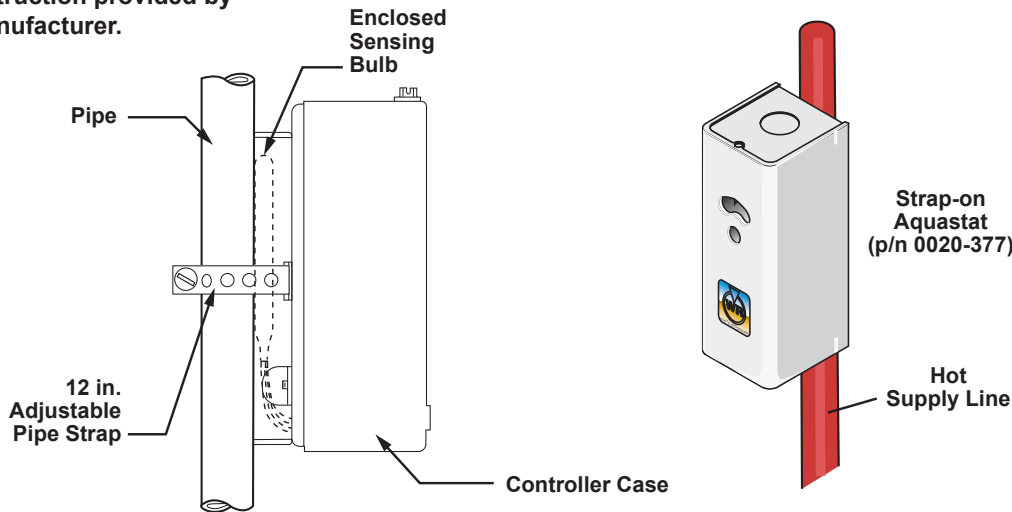

**NOTE**  
Strap-on Aquastat to be mounted on supply line of heat exchanger. Control will be sent to the "G" of Fan Control when aquastat is **above** set temperature, the fan will be on. Control will be sent to Thermostat when aquastat is **below** set temperature, the fan will function as normal.

**NOTE**  
Any electrical installation should be done by a qualified installer in accordance with applicable codes.

