

# Baseboard System

## (Three Way Zone Valve Controlled)


**NOTE**

Outdoor furnace water temperature setpoint should be set at 185°F minimum.

This horizontal assembly must not exceed a height of 4 inches above top of water heater.

**NOTE**

A pump must be installed in the hot supply line between the outdoor furnace and thermostatic valve.

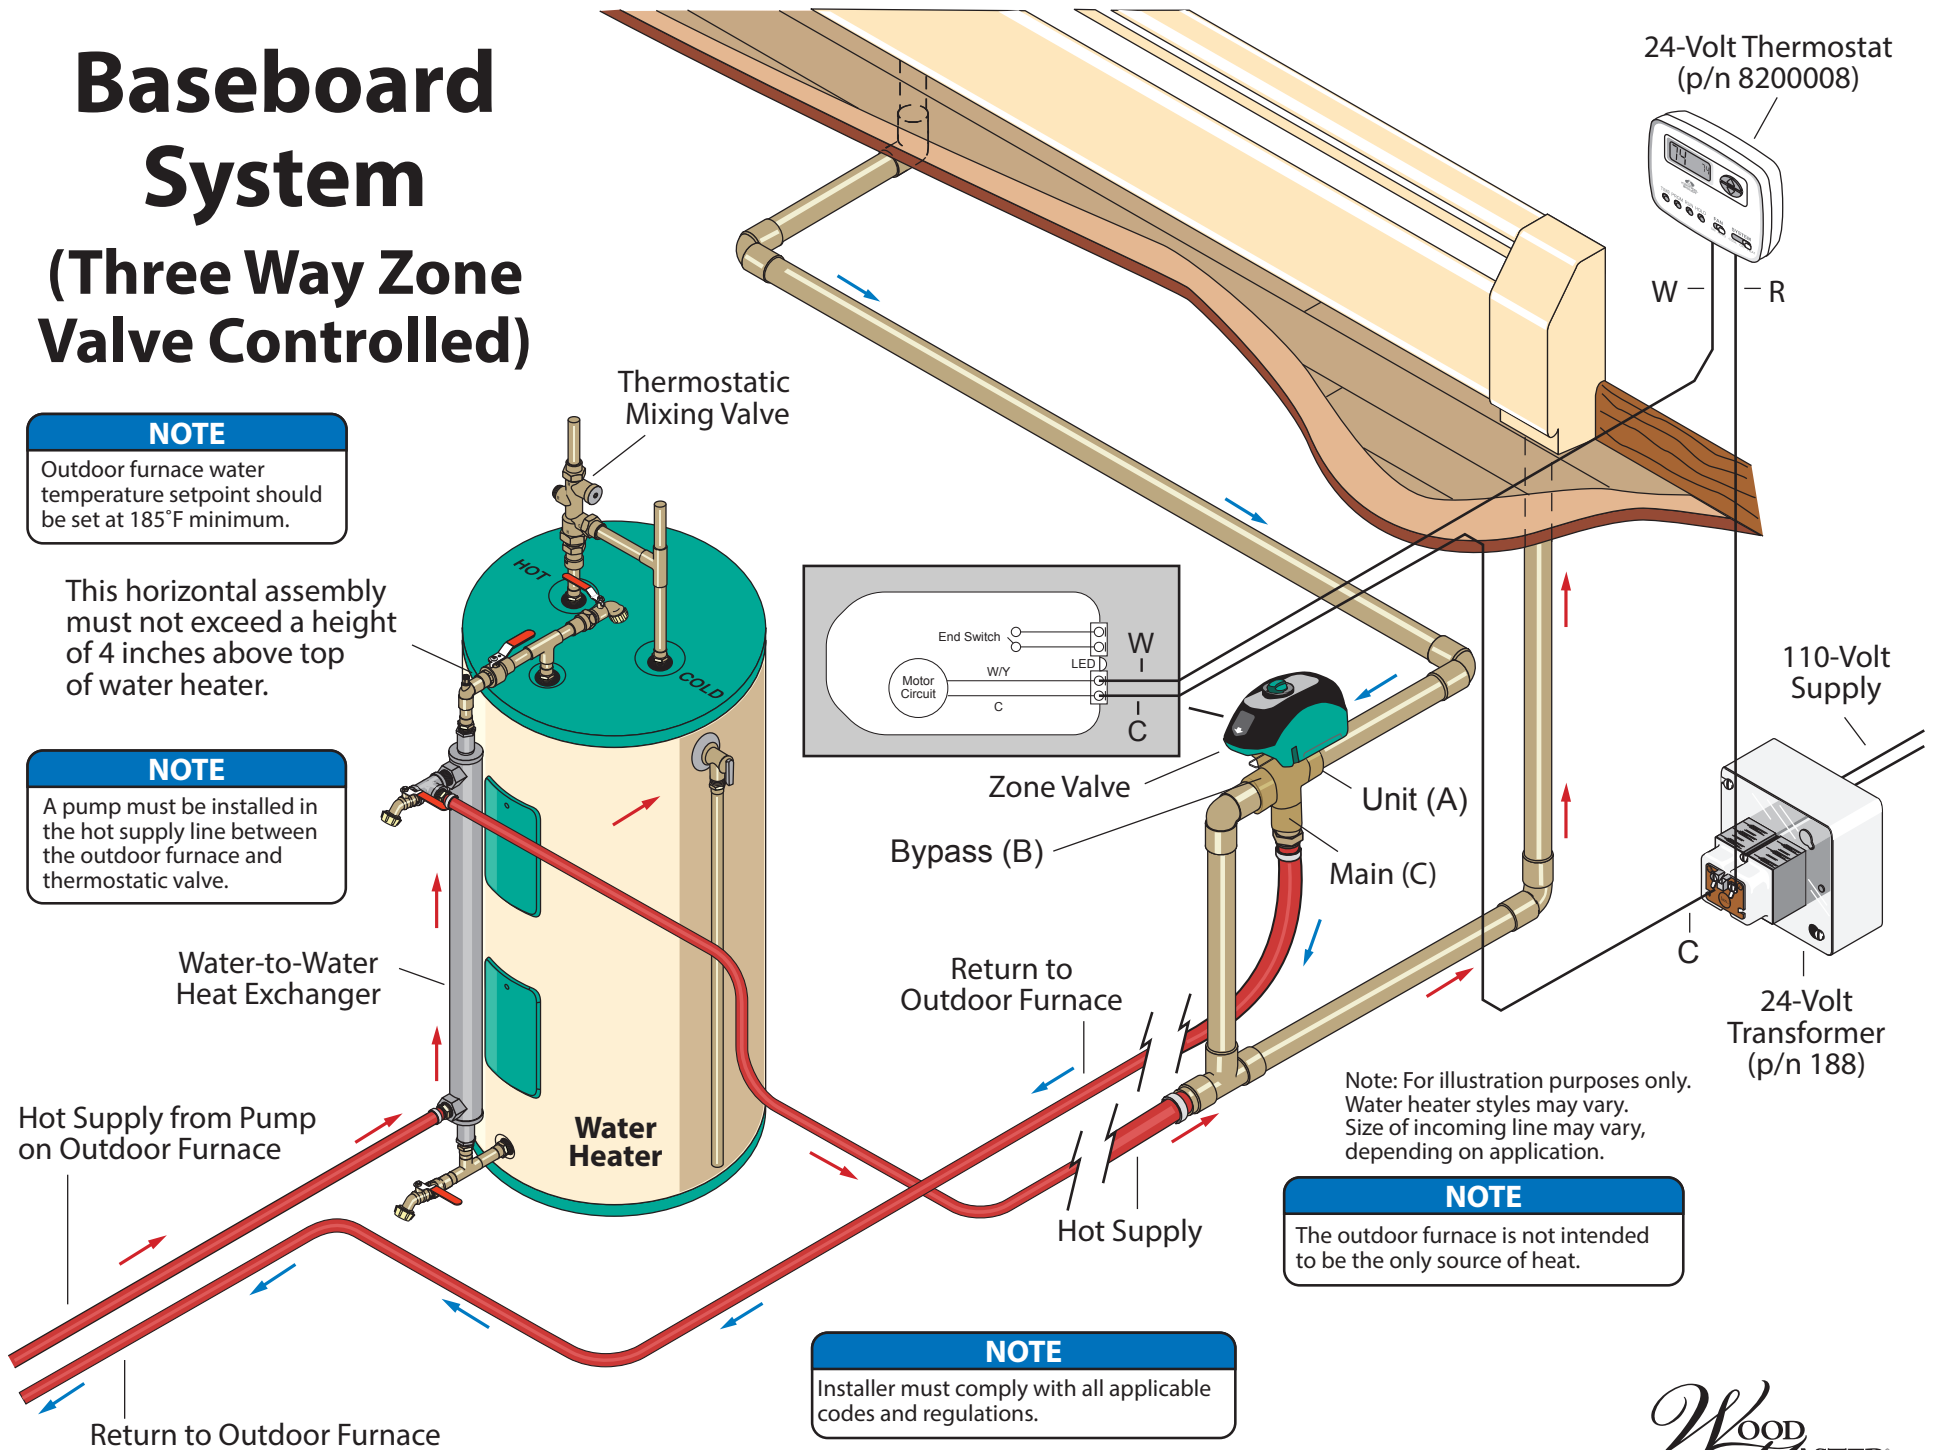

**NOTE**  
The outdoor furnace is not intended to be the only source of heat.

**NOTE**  
Installer must comply with all applicable codes and regulations.