



# Single Thermostat (with Aquastat)

- A - Strap-in Aquastat
- B - Surface Mount Aquastat
- C - Electronic Aquastat


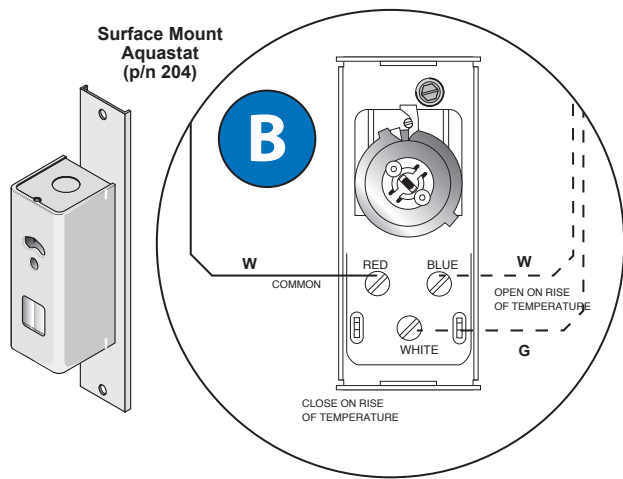


Existing 24V Thermostat

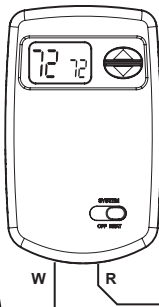

Existing thermostats may vary in style. This is an example illustration only.


Forced Air Furnace Thermostat Control

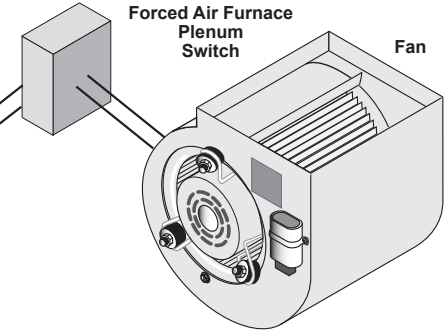

**NOTE**  
These are possible variations using an existing thermostat. If air conditioning is present, the air conditioner breaker may have to be shut off or a relay installed.

**NOTE**  
Any electrical installation should be done by a qualified installer in accordance with applicable codes.


A

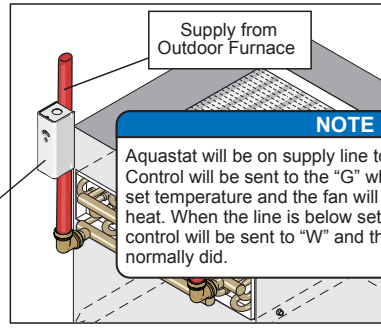


**NOTE**  
Aquastat will be on supply line to the heat exchanger. Control will be sent to the "G" when the line is above set temperature and the fan will turn on with a call for heat. When the line is below set temperature, the control will be sent to "W" and the furnace will fire as it normally did.

Strap-on Aquastat (p/n 0020-377)


Existing 24V Thermostat



Forced Air Furnace Thermostat Control



C

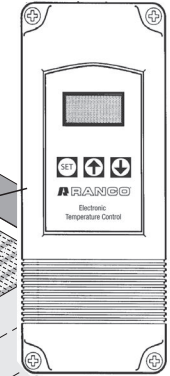

Electronic Aquastat (p/n 0020-376)

